



REFERENCES
GR&S UG.
STD. 1-17
STD. 1-43
STD. 1-44
STD. 11-1

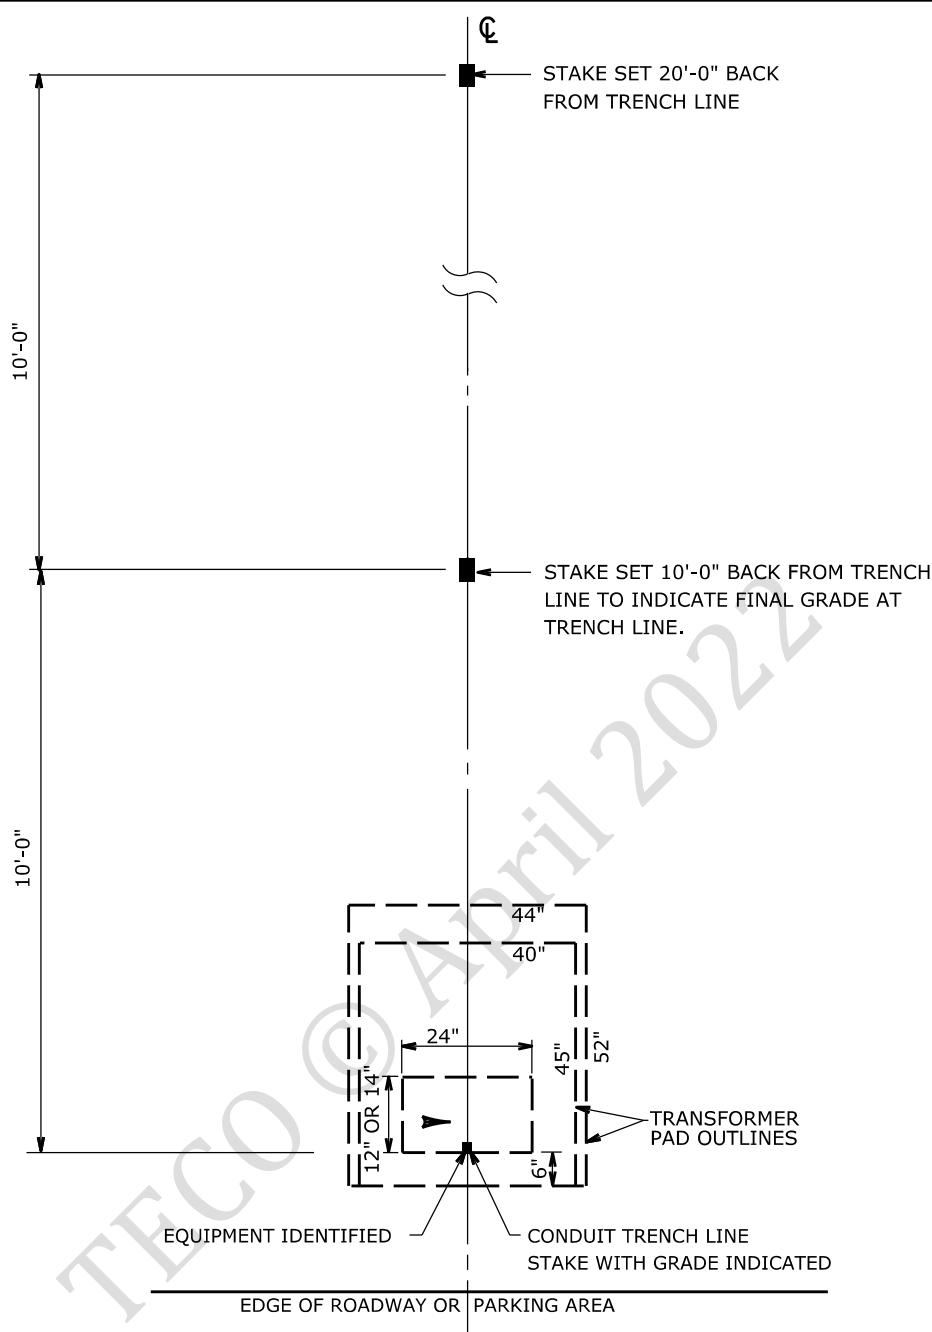

NOTES:

1. ALL STAKES TO BE INSTALLED BY DEVELOPER.
2. STAKES & GRADE REQUIRED EVERY 100' FOR CONDUIT TRENCH LINE, ON CURVED PORTIONS AT 25' INTERVALS, OR LESS IF REQUESTED.
3. STAKING REQUIRED FOR ALL TEC EQUIPMENT.
4. OFFSET STAKING REQUIRED FOR TEC EQUIPMENT - TRANSFORMERS, HANDHOLES, PULLBOXES, SWITCHGEAR/LBC, LIGHT



◀ DENOTES LATEST REVISION

NO.	CK'D	DATE	REVISION
5	RGH	4-22-05	REVISED NOTE 4 & ADDED LIGHT SYMBOL
4	MFK	8-18-05	REVISED REFERENCE BLOCK
3	MFK	8-18-05	REVISED NOTE 4 & REMOVED CONDUIT & S/L SYMBOL
2	CRM	10-16-03	TITLE CHANGE

STAKING REQUIREMENTS FOR APARTMENTS AND COMMERCIAL ZERO LOT LINE APPLICATIONS

D.S. SUPR. *Rahmskov*
 APPR. DATE 4-22-20
 SUPERSEDES 1-46/8-18-05