


REFERENCES	
GR&S	STD. 3-22
GR&S	UG.
STD.	1-19
STD.	8-12
SESR	7.39

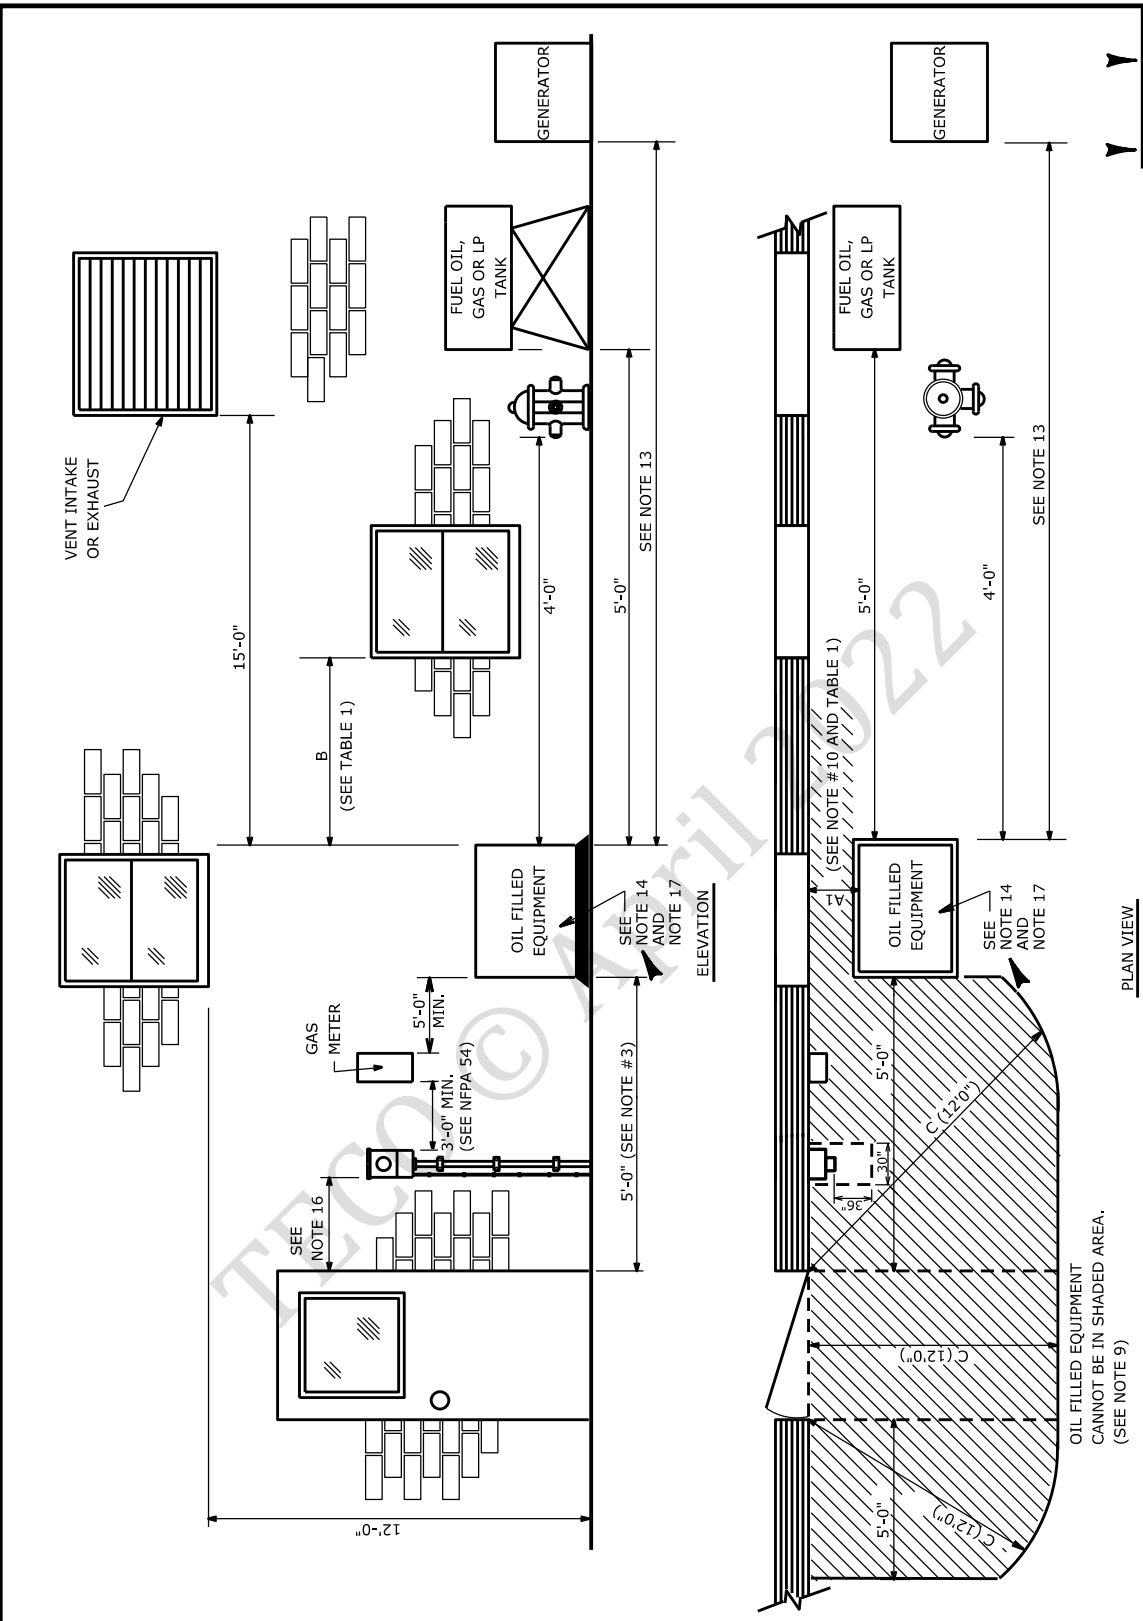

PLAN VIEW

SEE NOTES ON PAGE 2 OF 2

OIL FILLED EQUIPMENT CANNOT BE IN SHADED AREA. (SEE NOTE 9)

NO.	CK'D	DATE	REVISION
8	SJH	10-21-19	ADDED NEW NOTE 17 ON PAGE 2
7	TQB	6-15-15	ADDED NOTE 14 THAT WAS REVISED ON PAGE 2
6	TQB	6-15-15	ADDED 4'-0" FROM EQUIPMENT TO FIRE HYDRANT
5	RAG	3-19-09	ADD NOTE 16, NFPA 54 & DIMENSIONS AROUND METER CAN

◀ DENOTES LATEST REVISION

GRS 3-22

LOCATION OF OIL FILLED PAD-MOUNTED EQUIPMENT

MGR; STD'S
 APPR. DATE 10-21-19
 SUPERSEDES 1-17/3-19-09